


1/4" ASPHALTIC EXPANSION JOINT MATERIAL, BOTH SIDES. JOINT TOOLED TYP. AT 20' O.C. AND AT ALL LOCATIONS WHERE THE SIDEWALK ABUTS A CONCRETE CURB.

3000 PSI CONCRETE WITH 6% AIR ENTRAINMENT

TOOLED JOINT AT 5' O.C.

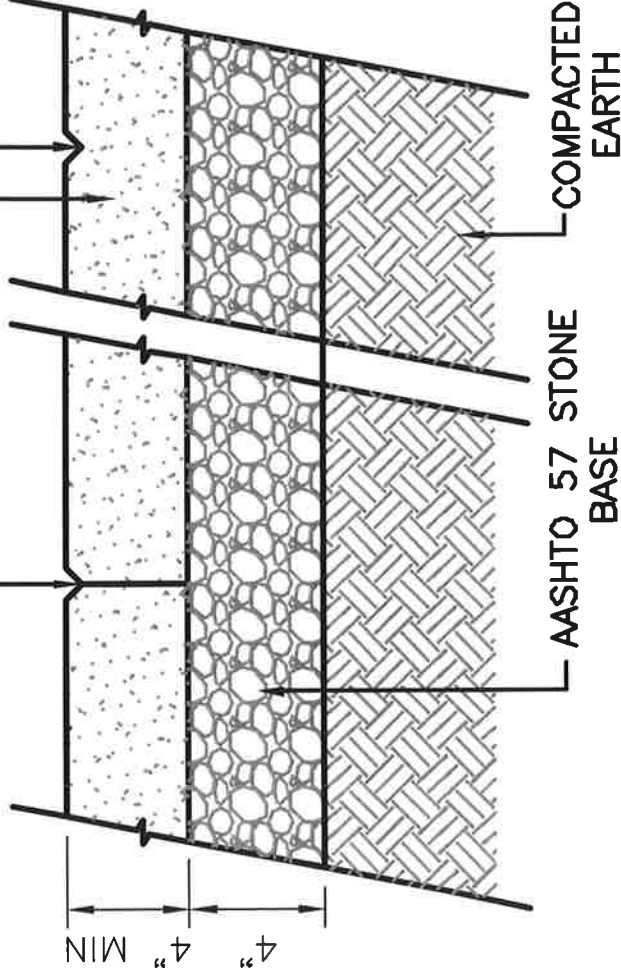

AASHTO 57 STONE BASE


COMPACTED EARTH

NOTES:

1. TOOL ALL EDGES
2. 1/4" PER. FT. CROSS SLOPE
3. BROOM OR BURLAP FINISH
4. SIDEWALK TO BE MIN. 4'-0" WIDE OR AS INDICATED ON THE PLAN
5. CONCRETE SHALL BE A MIN. OF 4" DEEP. WHERE CROSSING A DRIVEWAY THE DEPTH OF CONCRETE SHALL BE INCREASED TO 6" WITH REINFORCEMENT.

SIDEWALK DETAIL

NOT TO SCALE

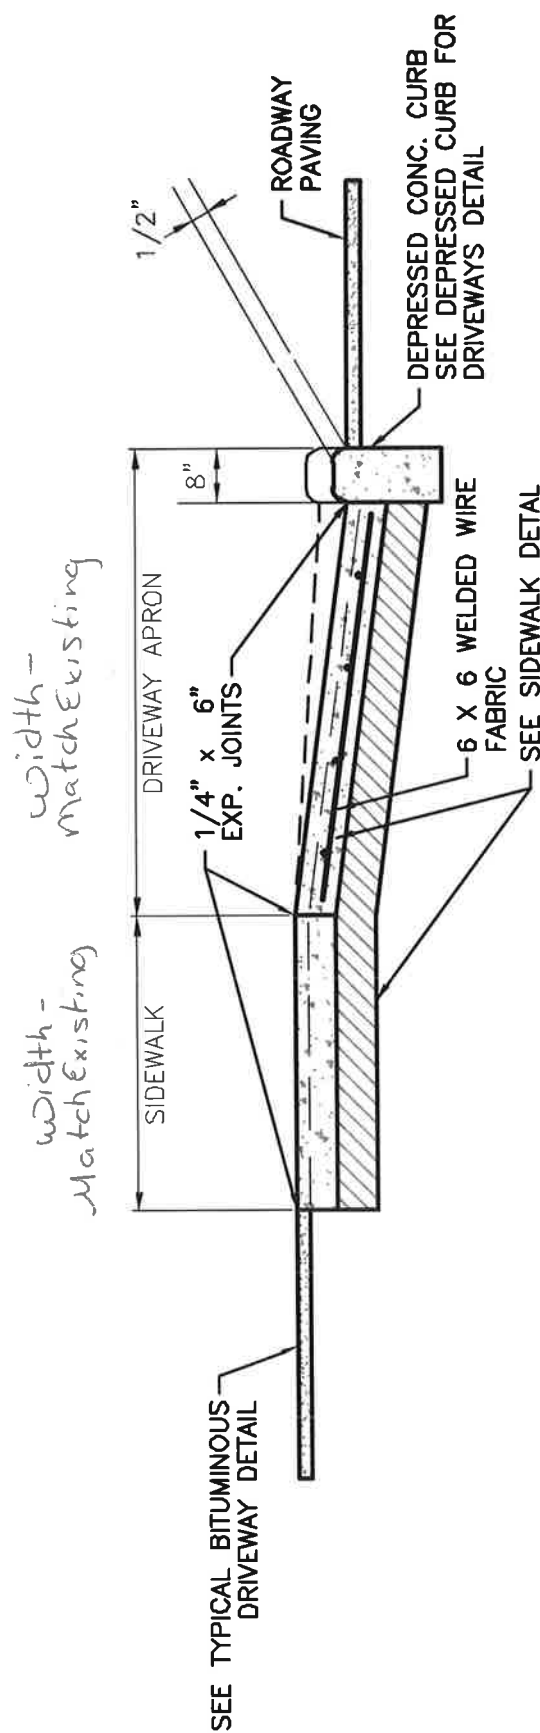

NOTES:

1. PROVIDE MATERIAL AND CONSTRUCTION METHODS MEETING THE REQUIREMENTS OF PENNDOT SPECIFICATIONS, PUBLICATION 408.
2. DRIVEWAY APRONS ON STREETS WITH CONCRETE CURBS AND / OR SIDEWALKS SHALL BE REINFORCED CONCRETE.
3. PLACE REINFORCEMENT 2" BELOW FINISHED GRADE OF CONCRETE.
4. PLACE REINFORCEMENT THROUGH THE SIDEWALK IN THE DRIVEWAY APRON SECTION.

REINFORCED CONCRETE APRON DETAIL

NOT TO SCALE